


Top Secret

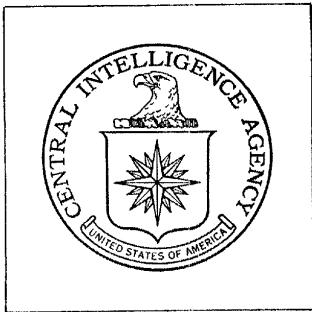

DIRECTORATE OF  
INTELLIGENCE

## Industrial Facilities (Non-Military)

## *Basic Imagery Interpretation Brief*

## Fu-shun Heat and Thermal Power Plant (Liao-ning)

Fu-shun, China

25X1A

Handle via Talent - Keyhole  
Channels Only

**Top Secret**

DECLASS REVIEW by NIMA/DOD

BCS 13/0027/69  
TCS 10020/68  
DATE SEPTEMBER 1968  
COPY 95  
08-3  
PAGES 3

## **WARNING**

This document contains information affecting the national security of the United States within the meaning of the espionage laws U. S. Code Title 18, Sections 793, 794. The law prohibits its transmission or the revelation of its contents in any manner to an unauthorized person, as well as its use in any manner prejudicial to the safety or interest of the United States or for the benefit of any foreign government to the detriment of the United States. It is to be seen only by personnel especially indoctrinated and authorized to receive information in the designated control channels. Its security must be maintained in accordance with regulations pertaining to TALENT-KEYHOLE Control System.



Approved For Release 2001/09/04 : CIA-RDP79T00909A000100010108-3

NAME **NPTC**

SEC. CLASS. LOCATION

mag-10000/69

Sept. 1968

TS/T/K


109443

INSTALLATION OR ACTIVITY NAME		COUNTRY		
Fu-shun Heat and Thermal Power Plant (Liao-ning)		CH		
25X1A	UTM COORDINATES 51TWG910415	GEOGRAPHIC COORDINATES 41-55-11N 124-05-32E	CATEGORY [REDACTED]	REF NUMBER [REDACTED]
25X1D	COMIREX NO. None	WAC-PIC NO. 0290-36B1	MAP REFERENCE 67 RTS. USATC Series 200, Sheet M0290-11HL, 4th edition, Jan 66, Scale 1:200,000 (SECRET NO FOREIGN DISSEM) [REDACTED] CONTROLLED DISSEM) 25X1C	
25X1A	LATEST IMAGERY USED [REDACTED]		NEGATION DATE (If required) Not Required	

INTRODUCTION

25X1A


The plant is located approximately 10 nautical miles (nm) east of Fu-shun and 2.2 nm north of the Fu-shun Dam and Hydro Power Plant Ta-huo-fang [REDACTED]

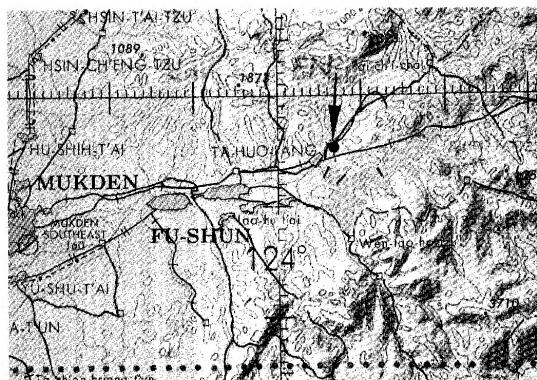

BASIC DESCRIPTION

The plant is secured within a walled area approximately 2,000 by 1,300 feet. It is coal operated and served by both road and rail. The boilerhouse is equipped with 13 boiler units and an accompanying dust catching system connected to three masonry stacks. Cooling water is obtained from a nearby river through two canals.

Smoke was emanating from the stacks on all referenced missions. No apparent changes have occurred since the date of information [REDACTED] in the referenced report. 25X1D

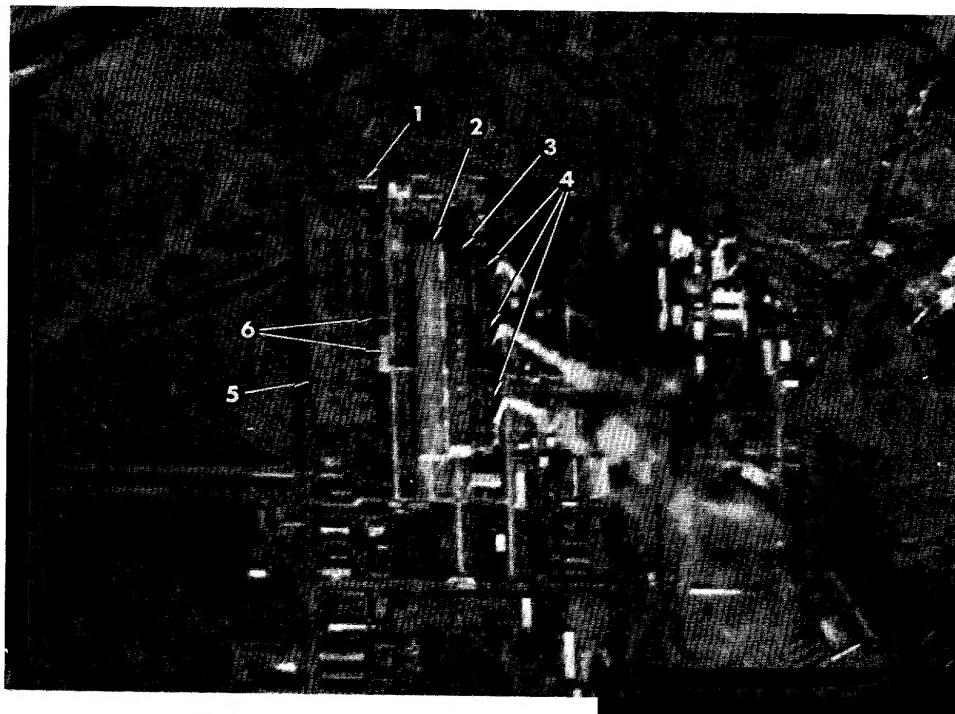

25X1D

Key to Annotations

<u>Item No.</u>	<u>Description</u>	<u>Measurements (ft)</u>	<u>Remarks</u>
1	Oil Storage Tanks (8)	-	-
2	Generator Hall	1,015 x 145	No. of generators is undetermined
3	Boilerhouse	1,000 x 115	13 boiler units
4	Dust Catcher and Flues (3 units)	-	3 stacks operating
5	Switching Yard	-	No. of transformers is undetermined
6	Control Houses (2)	180 x 65 65 x 60	-

25X1D

REFERENCES



Maps

25X1C

67 RTS. US Air Target Chart Series 200, Sheet M0290-11HL, 4th edition,  
Jan 66, Scale 1:200,000 (SECRET NO FOREIGN DISSEM) [REDACTED]

25X1C

ACIC. USAF Operational Navigation Chart, Sheet F-9, 1st edition, August 1966,  
Scale 1:1,000,000 (UNCLASSIFIED)

IMAGERY ANALYSIS SERVICE

Documents

I. CIA/IAD. PIR 75006, Chinese Power Plants, Liaoning Province, July 1966,  
TCS 3797/66 (TOP SECRET RUFF)

Requirement

EXSUBCOM - BR-N/002-69

**Top Secret**

Approved For Release 2001/09/04 : CIA-RDP79T00909A000100010108-3

**Top Secret**

Approved For Release 2001/09/04 : CIA-RDP79T00909A000100010108-3